

APPLYING UNCERTAINTY CONSIDERATIONS TO BUILDING ENERGY CONSERVATION EQUATIONS

Iain A Macdonald
Energy Systems Research Group
University of Strathclyde
Glasgow, Scotland
iain@esru.strath.ac.uk
<http://www.esru.strath.ac.uk>

ABSTRACT

When applying simulation tools in practice uncertainties abound, for example in material properties, casual heat gains and infiltration rates. To facilitate the quantification of the effects of uncertainties, the differential, factorial and Monte Carlo methods have been implemented within ESP-r.

An alternative approach is to embed uncertainty considerations within a simulation tool's algorithms. The principle advantages of this method are that the uncertainty is quantified at all times and therefore requires only a single simulation. Coupled with this, it is possible to take control action based on the prevailing effects of uncertainties.

This paper details the mathematical techniques required to integrate uncertainty considerations within the full set of building energy conservation equations. A comparison is made between the use of this novel approach and traditional mechanisms of assessing uncertainty. Finally, the advantages and disadvantages of the new approach are discussed.

INTRODUCTION

The quantification of uncertainty in the design process is necessary when applying simulation in practice to assess the risk in design decision making. This is due to the multitude of unknowns in a design, particularly at early design stages where simulation can be most effective.

The ESP-r system has been equipped with standard methods to quantify the effects of uncertainty [Macdonald and Strachan 2001]. The simulation engine is unaltered by these methods and is effectively treated as a black box, *i.e.* they are external to the core equation sets. Statistical inferences are used to quantify the effects of uncertainties. However, to achieve this, these external methods rely on multiple simulations of the deliberately perturbed data model. Furthermore, to calculate individual effects and the overall effect of uncertainty necessitates using different analysis methods: differential, factorial and Monte Carlo techniques. Therefore, to undertake a full analysis of the effects of uncertainty using external methods requires multiple analyses, each of which requires multiple simulations.

This paper proposes a more efficient approach whereby the uncertainty information is embedded within, and used throughout, the simulation process. This mechanism requires only a single simulation to quantify the effects of the uncertainties and would allow control of the simulation based on the prevailing effects of uncertainty. Methods within this approach have been classified as *internal* as they alter the core simulation engine. The new method is explained and its performance compared to that of the external methods.

CONSERVATION EQUATIONS

To integrate uncertainty considerations into a simulation engine requires the alteration of the underlying algorithms. As a prerequisite to describing the mathematics of the internal methods, the finite volume conservation equations are summarised.

The domain models for building simulation comprise a set of conservation equations for energy, mass and momentum with support equations corresponding to source terms. This paper focuses on the thermal domain where design decisions have a major impact.

Thermal modelling

The finite volume approach to building modelling requires the identification of typical control volume (or node) types [Clarke 2001]. Each of these types represent the energy transfer mechanisms occurring at the corresponding node. In a building there are three principal node types:

1. solid;
2. surface (solid/ fluid boundaries);
3. fluid.

There are also special cases of these types, *e.g.* solid nodes can be homogeneous or non-homogeneous, opaque or transparent. However, the energy balances remain essentially the same for each node type. Figure 1 summarises the various heat and mass transfer processes that may be included within the conservation equations corresponding to the three node types.

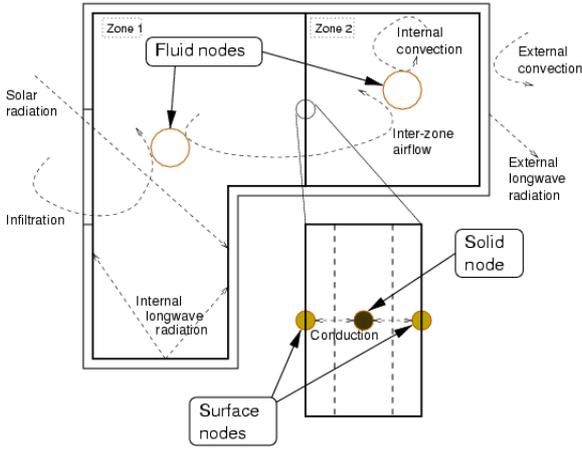


Figure 1: Building node types and heat flows.

To illustrate the uncertainty embedding process, this paper focuses on the energy balance for the solid node type.

Energy balance for solid nodes

The available mechanisms for heat transfer in a solid node are shown in figure 2. If the solid construction is opaque then the solar flux will be zero.

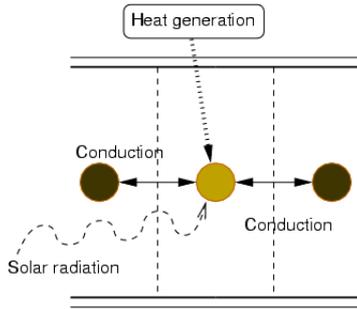


Figure 2: One dimensional heat transfer mechanisms at a solid node.

The energy balance can be stated as:

$$\begin{bmatrix} \text{Heat stored} \\ \text{in volume} \end{bmatrix} = \begin{bmatrix} \text{Net heat} \\ \text{conducted} \\ \text{into volume} \end{bmatrix} + \begin{bmatrix} \text{Heat} \\ \text{generated} \\ \text{in volume} \end{bmatrix},$$

or mathematically

$$\rho CV \frac{\partial \theta}{\partial t} = \sum_{i=1}^n k_i A_i \frac{\partial \theta}{\partial x} + q_{\text{generation}} + q_{\text{solar}} \quad (1)$$

where ρ is the density (kg/m^3), C the heat capacity (J/kgK), V the volume of the node (m^3), θ the temperature (K), t time (s), k the thermal conductivity (W/mK), A the area normal to heat flow (m^2), x the distance between nodes (m) and q_* is an additional heat flux (W) where $*$ is the type of flux¹. Each of the conductive flow paths (i) are treated separately as there may

¹Note: q_{solar} is the fraction of the solar flux absorbed at this node, which is a function of the solar transmissivity of the surrounding layers and any shading of the construction.

be different material properties in each flow direction. For heat flow in one dimension the total number of conductive flow paths is two.

Equation 1 is solved numerically by representing the partial derivatives by a truncated Taylor series for the current time row, t , and the future time row, $t + 1$. The expression for the current time row is explicit and conditionally stable, whereas the expression for the future time row is implicit and unconditionally stable. Combining these expressions gives rise to the well known and unconditionally stable Crank-Nicolson difference scheme:

$$\begin{aligned} & \left(2\rho C + \frac{2k\delta t}{(\delta x)^2} \right) \theta_{i,t+1} - \frac{k\delta t}{(\delta x)^2} (\theta_{i+1,t+1} + \theta_{i-1,t+1}) - \\ & \frac{q_{\text{plant},t+1}\delta t}{V} - \frac{q_{\text{solar},t+1}\delta t}{V} = \\ & \left(2\rho C - \frac{2k\delta t}{(\delta x)^2} \right) \theta_{i,t} + \frac{k\delta t}{(\delta x)^2} (\theta_{i+1,t} + \theta_{i-1,t}) + \\ & \frac{q_{\text{plant},t}\delta t}{V} + \frac{q_{\text{solar},t}\delta t}{V}. \end{aligned} \quad (2)$$

This is the general form of the equation for a solid node, where V is the node volume. Equations for other node types are also necessary for the full building energy conservation equation set, for example see Clarke [2001].

The nodal equations are then formed into a set of simultaneous equations:

$$\mathbf{A} \cdot \theta_{t+1} = \mathbf{B} \cdot \theta_t \quad (3)$$

where the coefficients of \mathbf{A} correspond to the future time row and the coefficients of \mathbf{B} are for the present time row. This set of simultaneous equations must now be solved for each simulation time step. The following sections describe arithmetical models which can be applied to this system of equations to enable the integrated quantification of uncertainty.

INTERNAL METHODS

Internal methods are based on interval or range arithmetic [Moore 1966, Neumaier 1990]. The most basic method is interval arithmetic, which in its general form is fuzzy arithmetic. Another method in this class is affine arithmetic, a linear polynomial whose terms are interval numbers. The interval and affine approaches are described below.

Interval Numbers

An interval number, x , is defined as a range of values, all equally probable, with a lower bound defined as \underline{x} and an upper bound defined as \bar{x} . A specific element of x is defined as \tilde{x} , or mathematically,

$$x \equiv [\underline{x}, \bar{x}] := \{ \tilde{x} \in \mathbb{R} | \underline{x} \leq \tilde{x} \leq \bar{x} \}. \quad (4)$$

Table 1: Interval multiplication (xy)

	$y \geq 0$	$y \ni 0$	$y \leq 0$
$x \geq 0$	$[\underline{xy}, \overline{xy}]$	$[\overline{xy}, \underline{xy}]$	$[\overline{xy}, \underline{xy}]$
$x \ni 0$	$[\underline{xy}, \overline{xy}]$	$[\min(\underline{xy}, \overline{xy}), \max(\underline{xy}, \overline{xy})]$	$[\overline{xy}, \underline{xy}]$
$x \leq 0$	$[\underline{xy}, \overline{xy}]$	$[\underline{xy}, \overline{xy}]$	$[\overline{xy}, \underline{xy}]$

Table 2: Interval division (x/y)

	$y > 0$	$y < 0$
$x \geq 0$	$[\underline{x}/\overline{y}, \overline{x}/\underline{y}]$	$[\overline{x}/\overline{y}, \underline{x}/\underline{y}]$
$x \ni 0$	$[\underline{x}/\overline{y}, \overline{x}/\underline{y}]$	$[\overline{x}/\overline{y}, \underline{x}/\underline{y}]$
$x \leq 0$	$[\underline{x}/\overline{y}, \overline{x}/\underline{y}]$	$[\overline{x}/\overline{y}, \underline{x}/\underline{y}]$

Binary functions

The binary operators, $\circ := \{+, -, *, /\}$ can be applied to intervals where the largest interval resulting from the binary operation is to be found:

$$x \circ y := \{\tilde{x} \circ \tilde{y} | \tilde{x} \in x, \tilde{y} \in y\} \quad (5)$$

for all x, y defined in the set of real interval numbers. This restricts the division function to exclude any interval where $0 \in y$. Representing the interval numbers x and y as $x = [\underline{x}, \overline{x}]$ and $y = [\underline{y}, \overline{y}]$, equation 5 can be expanded as follows

$$x \circ y := \square\{\underline{x} \circ \underline{y}, \underline{x} \circ \overline{y}, \overline{x} \circ \underline{y}, \overline{x} \circ \overline{y}\} \quad (6)$$

where \square is a function describing the set containing the four calculated values. It is possible to calculate the end points of \square directly in most cases. For addition and subtraction see equations 7, for multiplication see table 1, and for division see table 2.

$$\begin{aligned} x + y &= [\underline{x} + \underline{y}, \overline{x} + \overline{y}] \\ x - y &= [\underline{x} - \overline{y}, \overline{x} - \underline{y}] \end{aligned} \quad (7)$$

Affine arithmetic

The affine model is a linear transformation of the uncertain quantity where the uncertainty associated with the data is held as a separate token (e.g. π could be represented as $3 \leq \pi \leq 4$ or $3.5 + 0.5\epsilon_1$, where ϵ_1 is the first uncertainty token and $\epsilon_1 = [-1, 1]$); each value of the number is equally likely between the limits of the range as in interval arithmetic [Stolfi and de Figueiredo 1997]. Again the underlying arithmetical operations have to be redefined.

Affine Numbers

An affine number, \hat{x} , is defined as a range of values, all equally probable, via a first-degree polynomial. A specific element of \hat{x} is defined as \tilde{x} , or mathematically

$$\tilde{x} := \hat{x} = x_0 + x_1\epsilon_1 + x_2\epsilon_2 + \dots + x_n\epsilon_n. \quad (8)$$

The x_i for $i \geq 1$ are uncertainty coefficients (e.g. if \hat{x} represented conductivity then x_0 would be the average conductivity and x_i for $i \geq 1$ would be the uncertainty due to temperature, moisture content *etc*) and the ϵ_i are defined as the interval $[-1, 1]$. Each ϵ_i can thus assume any value between -1 and 1 , the overall uncertainty in x being the linear combination of these uncertainties.

Each x_i represents an independent source of uncertainty, either inherently associated with the data or as a result of a calculation, e.g. round-off error. Clearly this representation will result in more complicated arithmetic than ordinary interval arithmetic.

The total uncertainty in an affine number is the sum of the uncertainty tokens,

$$\sum_{i=1}^N |x_i|,$$

and the effect of the individual sources of uncertainty is the magnitude of each uncertainty token, x_i .

Affine operations

An affine operation is an operation which can be expanded into an affine combination of the uncertainty tokens:

$$\hat{x} \circ \hat{y} = x_0 \circ y_0 + \sum_{i=1}^N (x_i \circ y_i)\epsilon_i, \quad (9)$$

where N is the greatest number of uncertainty tokens in x and y . Also note that it is not necessary for all uncertainty tokens to be defined. Three instances of the above are addition, subtraction and multiplication by a constant:

$$\begin{aligned} x + y &= (x_0 + \sum_{i=1}^N x_i\epsilon_i) + (y_0 + \sum_{j=1}^N y_j\epsilon_j) \\ &= x_0 + y_0 + \sum_{k=1}^N (x_k\epsilon_k + y_k\epsilon_k), \end{aligned} \quad (10)$$

$$\begin{aligned} x - y &= (x_0 + \sum_{i=1}^N x_i\epsilon_i) - (y_0 + \sum_{j=1}^N y_j\epsilon_j) \\ &= x_0 - y_0 + \sum_{k=1}^N (x_k\epsilon_k - y_k\epsilon_k), \end{aligned} \quad (11)$$

$$\begin{aligned} \alpha x &= \alpha(x_0 + \sum_{i=1}^N x_i\epsilon_i) \\ &= \alpha x_0 + \sum_{k=1}^N \alpha x_k\epsilon_k. \end{aligned} \quad (12)$$

For example:

$$\begin{aligned} \hat{x} &= 10 + 4\epsilon_1 - 2\epsilon_3, \\ \hat{y} &= 3 + 1\epsilon_1 + 4\epsilon_2, \\ \hat{x} + \hat{y} &= 13 + 5\epsilon_1 + 4\epsilon_2 - 2\epsilon_3. \end{aligned}$$

Note that the uncertainty tokens can cancel themselves out, *e.g.* $(\hat{y} - \hat{x}) + \hat{x} = \hat{y}$, which was not the case for interval arithmetic. This is useful for numerical techniques and equation sets, for example equation 2.

Non-affine operations

A non-affine operation is a function which cannot be expressed as affine combinations of the uncertainty tokens, *e.g.* multiplication of two affine numbers results in a series of quadratic terms. The process to follow is to map the solution to an affine number; thus the series of quadratic terms becomes a new uncertainty token:

$$\hat{x} \circ \hat{y} = x_0 \circ y_0 + \sum_{i=1}^N (x_i \circ y_i) \epsilon_i + \delta \epsilon_{N+1}. \quad (13)$$

Note the inclusion of the new uncertainty token (cf. equation 9). This new uncertainty token is now defined to be independent of all of the other uncertainty tokens: this is clearly not the case so the evaluation of the non affine operation should produce the best solution possible in terms of minimizing this new term.

Multiplication of affine numbers

The multiplication of two affine numbers results in a quadratic term:

$$\begin{aligned} \hat{x} \cdot \hat{y} &= \left(x_0 + \sum_{i=1}^N x_i \epsilon_i \right) \cdot \left(y_0 + \sum_{j=1}^N y_j \epsilon_j \right) \\ &= x_0 \cdot y_0 + \sum_{i=1}^N (x_0 y_i + y_0 x_i) \epsilon_i \\ &\quad + \left(\sum_{i=1}^N x_i \epsilon_i \right) \cdot \left(\sum_{i=1}^N y_i \epsilon_i \right). \end{aligned} \quad (14)$$

The quadratic term

$$\begin{aligned} Q &= \left(\sum_{i=1}^N x_i \epsilon_i \right) \cdot \left(\sum_{i=1}^N y_i \epsilon_i \right) \\ &= \sum_{i=1}^N \sum_{j=1}^N x_i y_j \epsilon_i \epsilon_j \end{aligned} \quad (15)$$

is approximated. The best approximation [Stolfi and de Figueiredo 1997] is a constant function of the maximum and minimum values of the quadratic. If

$$\begin{aligned} a &= \max Q \\ b &= \min Q \end{aligned}$$

then the approximation is

$$\begin{aligned} Q &\approx \frac{a+b}{2} + \frac{b-a}{2} \epsilon_{N+1} \\ &= \gamma + \delta \epsilon_{N+1} \end{aligned} \quad (16)$$

where $\gamma = \frac{a+b}{2}$, $\delta = \frac{b-a}{2}$, and ϵ_{N+1} is a new uncertainty token. The affine approximation of multiplication becomes

$$\hat{x} \cdot \hat{y} = x_0 \cdot y_0 + \gamma + \sum_{i=1}^N (x_0 y_i + y_0 x_i) \epsilon_i + \delta \epsilon_{N+1}. \quad (17)$$

Due to the difficulty of calculating the bounds of the quadratic term, it is usually estimated as [Stolfi and de Figueiredo 1997]

$$Q \approx \left(\sum_{i=1}^N |x_i| \cdot |y_i| \right) \epsilon_{N+1}. \quad (18)$$

The resulting affine approximation of multiplication becomes

$$\hat{x} \cdot \hat{y} = x_0 \cdot y_0 + \sum_{i=1}^N (x_0 y_i + y_0 x_i) \epsilon_i + Q \epsilon_{N+1}. \quad (19)$$

Division is achieved by using a min-range approximation to calculating the reciprocal of the divisor and then multiplying the result as described above. This method produces two new uncertainty tokens, which are uncorrelated to the existing terms as described elsewhere [Stolfi and de Figueiredo 1997].

Implementation of internal methods

The internal methods require only a single simulation to quantify the individual and overall effects. It was found when forming the energy balance equation set, that correlations between the source of uncertainty and the equation terms should be maintained. This is necessary so that uncertain parameters have the same value when used in different terms in the equation set. For example, the uncertainty in conduction into and out of a homogeneous control volume will be correlated because the uncertainty is related to the materials properties. Note that conductivity appears in four terms in equation 2.

Only affine arithmetic accounts for these correlations. To achieve this, uncertainty considerations are embodied within the underlying conservation equations using a first order polynomial representation of uncertainty. This polynomial is formed from the mean value of the parameter with the individual uncertainties defined as separate terms. Each uncertainty term is represented by an interval number. The resulting predictions (state variables) are likewise represented by affine numbers.

Recall the general equation for transient conduction at a solid node (equation 2). This equation is now extended to include uncertainties through the use of affine arithmetic.

The fundamental energy balance for the node is unchanged since no new energy flow paths are created. However, the physical properties affecting the energy

$$\begin{aligned}
& \left(2(\rho_{i,0} + \sum_{j=1}^{\nu} \rho_{i,j}\epsilon_j)(C_{i,0} + \sum_{j=1}^{\nu} C_{i,j}\epsilon_j) + \frac{2(k_{i,0} + \sum_{j=1}^{\nu} k_{i,j}\epsilon_j)\delta t}{(\delta x_{i,0} + \sum_{j=1}^{\nu} \delta x_{i,j}\epsilon_j)^2} \right) (\theta_{i,t+1,0} + \sum_{j=1}^{\nu} \theta_{i,t+1,j}\epsilon_j) \\
& - \frac{(k_{i,0} + \sum_{j=1}^{\nu} k_{i,j}\epsilon_j)\delta t}{(\delta x_{i,0} + \sum_{j=1}^{\nu} \delta x_{i,j}\epsilon_j)^2} \left((\theta_{i+1,t+1,0} + \sum_{j=1}^{\nu} \theta_{i+1,t+1,j}\epsilon_j) + (\theta_{i-1,t+1,0} + \sum_{j=1}^{\nu} \theta_{i-1,t+1,j}\epsilon_j) \right) \\
& - \frac{(q_{\text{plant},i,t+1,0} + \sum_{j=1}^{\nu} q_{\text{plant},i,t+1,j}\epsilon_j)\delta t}{(V_{i,0} + \sum_{j=1}^{\nu} V_{i,j}\epsilon_j)} - \frac{(q_{\text{solar},i,t+1,0} + \sum_{j=1}^{\nu} q_{\text{solar},i,t+1,j}\epsilon_j)\delta t}{(V_{i,0} + \sum_{j=1}^{\nu} V_{i,j}\epsilon_j)} = \\
& \left(2(\rho_{i,0} + \sum_{j=1}^{\nu} \rho_{i,j}\epsilon_j)(C_{i,0} + \sum_{j=1}^{\nu} C_{i,j}\epsilon_j) - \frac{2(k_{i,0} + \sum_{j=1}^{\nu} k_{i,j}\epsilon_j)\delta t}{(\delta x_{i,0} + \sum_{j=1}^{\nu} \delta x_{i,j}\epsilon_j)^2} \right) (\theta_{i,t,0} + \sum_{j=1}^{\nu} \theta_{i,t,j}\epsilon_j) \\
& + \frac{(k_{i,0} + \sum_{j=1}^{\nu} k_{i,j}\epsilon_j)\delta t}{(\delta x_{i,0} + \sum_{j=1}^{\nu} \delta x_{i,j}\epsilon_j)^2} \left((\theta_{i+1,t,0} + \sum_{j=1}^{\nu} \theta_{i+1,t,j}\epsilon_j) + (\theta_{i-1,t,0} + \sum_{j=1}^{\nu} \theta_{i-1,t,j}\epsilon_j) \right) \\
& + \frac{(q_{\text{plant},i,t,0} + \sum_{j=1}^{\nu} q_{\text{plant},i,t,j}\epsilon_j)\delta t}{(V_{i,0} + \sum_{j=1}^{\nu} V_{i,j}\epsilon_j)} + \frac{(q_{\text{solar},i,t,0} + \sum_{j=1}^{\nu} q_{\text{solar},i,t,j}\epsilon_j)\delta t}{(V_{i,0} + \sum_{j=1}^{\nu} V_{i,j}\epsilon_j)} \quad (20)
\end{aligned}$$

transfer mechanisms are now functions of their inherent uncertainties. Recalling the definition of an affine number, the representation of an uncertain conductivity, for example, at node i is given by

$$k_i = k_{i,0} + \sum_{j=1}^{\nu} k_{i,j}\epsilon_j$$

where $k_{i,0}$ is the average value of conductivity and $k_{i,j}\epsilon_j$ represents the variation in conductivity due to each of ν sources of uncertainty. Likewise, all other terms in equation 2 can be represented in their affine forms. The length of time step, δt , is imposed on the solution process by the user and as such has no associated uncertainty. All of the remaining parameters are functions of the building being modelled:

- ρ , C and k are properties of the materials and are susceptible to measurement errors and uncertainties due to moisture content *etc*;
- δx is the thickness of the element and is subject to measurement errors and construction uncertainties (likewise the volume, V , of the node); and
- the various fluxes are also uncertain, *e.g.* plant losses might be less than or greater than expected, and solar gain will reduce over time due to the accumulation of a dirt film on the glazing. The magnitude of these uncertainties will be calculated elsewhere, *e.g.* during the calculation of the solar flux absorbed/ transmitted by/ through the glazing.

As a result of these uncertainties, the temperature of the node will itself be uncertain. The end result is that equation 2 becomes equation 20.

As can be seen in equation 20 the uncertain parameters are now represented by affine numbers. The state variable, θ , is likewise represented in an affine form. In this manner the uncertainty in the parameters will be accounted for during a simulation and will be quantified in the state variables.

This is the general conservation equation for a solid node with uncertainties included. It should be noted that for any given set of values for the uncertainty tokens (ϵ_j), equation 20 reduces to equation 2. Recall that the numbering of uncertainty tokens is consistent throughout the model and therefore uncertainty tokens for all properties can be related. For example, if density and specific heat capacity have a magnitude associated with uncertainty token j then both properties are implicitly defined as being correlated. If an uncertainty is not applicable to a parameter then its magnitude is zero.

VERIFICATION OF THE AFFINE MODEL

Two simulation programs were used to verify the affine approach to uncertainty modelling:

1. one using the original ESP-r program; and
2. the other embodying an affine representation.

For both simulation programs the model used was simulated with and without uncertainties applied. Recall that the affine approach only requires a single simulation for a given set of uncertainties compared with the multiple simulations required by external methods for the same set of uncertainties.

CEN standard conduction test

This test requires the prediction of internal air temperatures inside a $1m^3$ zone at several time intervals after a step change has been made to the ambient air temperature [CEN 1997]. Three different constructions were tested. In each test all surfaces in the zone were given the same construction. The material properties used within the tests are shown in table 3. Each surface in the zone has identical boundary conditions.

The zone is subjected to a step change of $10^\circ C$ in ambient air temperature as depicted in figure 3 and the change in internal air temperature is recorded.

Table 3: Constructions used in tests.

Material	Conductivity k (W/mK)	Density ρ (kg/m ³)	Specific heat capacity C (kJ/kgK)	Layer thickness s (m)
Render	1.20	2000	1.0	0.20
Insulation	0.04	50	1.0	0.10
Paper	0.14	800	1.5	0.005

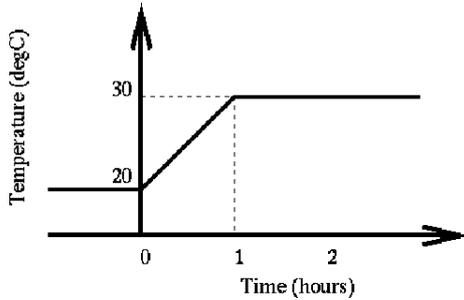


Figure 3: Variation of ambient air temperature.

Results without uncertainties

The initial simulations were run without uncertainties defined. This simple inter-model comparison was used to verify the affine model. As can be seen in tables 4 and 5, and figure 4, the affine model compares favourably with the ESP-r solution without uncertainties.

Results with uncertainties

A systematic test of the effects of including uncertainties was undertaken. A factorial design provides the best test methodology as all possible combinations of the test states are analysed. Such a process involves many tests for all possible parameters and their combinations. The following test sequence was devised.

1. Test each parameter individually at uncertainties of 1%, 5% and 10%.
2. Test combinations of two parameters at the same uncertainty levels.
3. Continue with more parameters being included.

There are only three parameters that are available for assigning uncertainties in the base case model: conductivity, heat capacity (either the density or specific heat capacity) and thickness. In total 64 simulations were executed and analysed. This includes the simulation with zero uncertainty in all parameters: the remaining 63 simulations are reported elsewhere [Macdonald 2002].

Table 4: Affine solution without uncertainty.

Time (hours)	Case		
	1	2	3
1	20.02	21.43	27.65
2	20.10	25.10	29.97
6	21.29	29.60	30.00
12	23.44	29.99	30.00
24	26.36	30.00	30.00
120	29.97	30.00	30.00
∞	29.97	30.00	30.00

Table 5: Original ESP-r predictions without uncertainty.

Time (hours)	Case		
	1	2	3
1	19.99	21.35	27.80
2	20.04	25.14	29.96
6	21.31	29.61	29.99
12	23.48	29.98	29.99
24	26.37	29.99	29.99
120	29.99	29.99	29.99

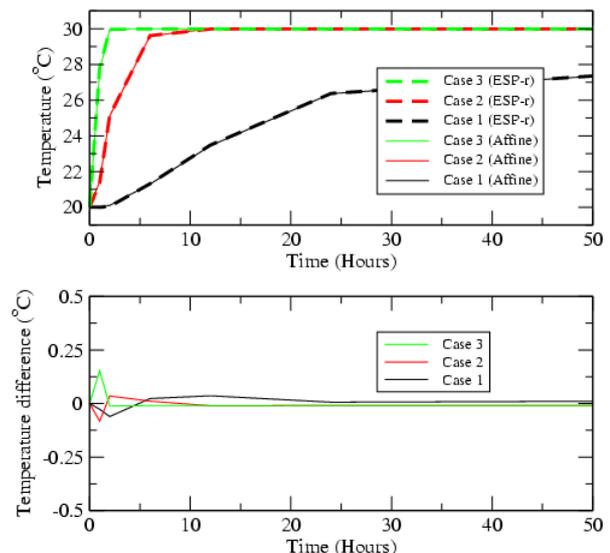


Figure 4: Air temperature for standard tests.

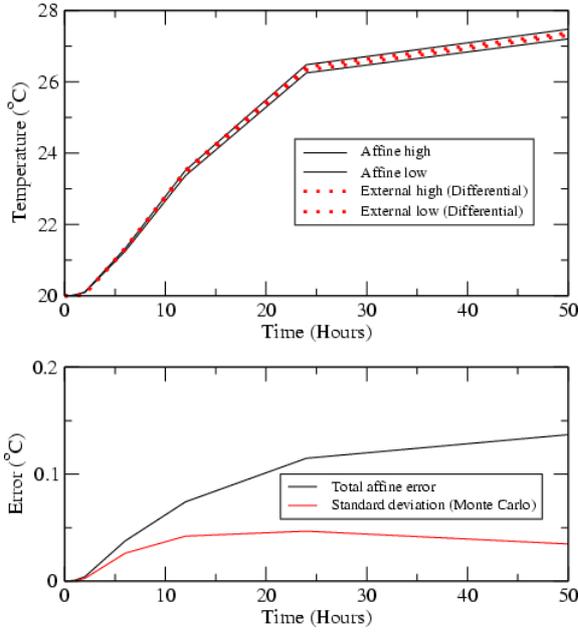


Figure 5: Air temperature for case 2.

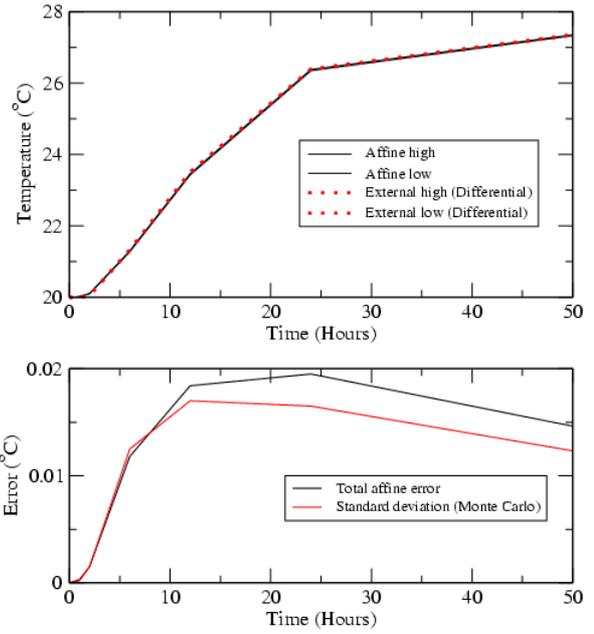


Figure 6: Air temperature for case 1.

The results may be summarised as follows.

1. Fully converged: the individual uncertainty tokens and the sum of the uncertainty tokens tend to zero as the simulation time tends to infinity for all three cases, for example table 6. Two simulations fall into this category and are discussed below.
2. Partially converged: the individual uncertainty tokens converge but the sum of the tokens does not, *i.e.* individual effects are quantified but the overall uncertainty is not, for example see figure 5. Fifty of the simulations fall into this category.
3. Divergent solutions: neither the individual uncertainty tokens nor the sum of the tokens converge, *i.e.* both individual and overall effects are not quantified. Eleven simulations fall into this category.

The reasons for non-convergence (partial in case 2 and full in case 3) are mainly due to non-affine operations, which introduce new uncertainty terms that are uncorrelated to existing terms. Methods to minimise the size of these new terms are currently being sought.

A typical example from the fully converged category is now discussed and compared with results from appropriate external methods.

Discussion

The results from a fully converged solution are presented in table 6. As can be seen, for each case the uncertainty token θ_{con} and the sum of the uncertainty tokens (these include the results of non affine operations) tends to zero as time tends to infinity. These results are commensurate with expectations of the behaviour of the physical system.

If the conductivity were to increase by 1% then $\epsilon_{con} = 1$ and the resulting air temperatures would then be $\theta_0 + \theta_{con}$ at all times. This is a sensible result. The value of θ_{con} represents the uncertainty in temperature due to the first order effects of the uncertainty in conductivity. The total uncertainty includes the effects due to non affine operations. As expected, the total uncertainty is greater than the first order effects. It should also be observed that the integrity of the physical system is maintained, *i.e.* no temperatures greater than $30^\circ C$ are possible for all values of ϵ_i and the uncertainty in temperature reduces to zero as the system reaches steady state. Finally, if the uncertainty in conductivity was zero (*i.e.* $\epsilon_{con} = 0$) then the same results as the simulation without uncertainty are achieved (table 4).

Differential and Monte Carlo analyses were undertaken to enable a comparison with the above results (these methods are already integrated within ESP-r and have been described previously [Macdonald and Strachan 2001]). Table 7 shows the results of these simulations: the $\delta\theta^+$ and $\delta\theta^-$ values relate to the differential analysis and the σ values relate to the Monte Carlo analysis; as expected the two analysis methods produce effectively the same results. As can be seen in figure 6 the total affine error ($\sum |\theta_i|$) is of the same magnitude as the standard deviation predicted by an 80 run Monte Carlo analysis. The individual effect of the uncertainty in conductivity (θ_{con} in table 6) is also similar to the variation predicted by the differential analysis ($\delta\theta^+$ and $\delta\theta^-$ in table 7).

From these data it can be concluded that the affine solution shows good agreement with the traditional external methods.

Table 6: Affine solution for conductivity uncertainty of 1%.

Time (hours)	Case 1			
	θ_0	θ_{con}	$\sum \theta_i$	$\sum \theta_i $
1	20.0172	0.0003	0.0003	0.0003
2	20.1009	0.0014	0.0014	0.0015
6	21.2866	0.0114	0.0117	0.0118
12	23.4442	0.0172	0.0180	0.0184
24	26.3645	0.0170	0.0187	0.0195
120	29.9676	0.0007	0.0013	0.0015
∞	29.9734	0.0006	0.0011	0.0013

Time (hours)	Case 2			
	θ_0	θ_{con}	$\sum \theta_i$	$\sum \theta_i $
1	21.4323	0.0166	0.0169	0.0171
2	25.1049	0.0401	0.0415	0.0421
6	29.5986	0.0126	0.0144	0.0150
12	29.9906	0.0006	0.0008	0.0009
24	30.0000	0.0000	0.0000	0.0000
∞	30.0000	0.0000	0.0000	0.0000

Time (hours)	Case 3			
	θ_0	θ_{con}	$\sum \theta_i$	$\sum \theta_i $
1	27.6470	0.0028	0.0060	0.0077
2	29.9723	0.0001	0.0046	0.0068
6	30.0000	0.0000	0.0023	0.0034
12	30.0000	0.0000	0.0006	0.0010
∞	30.0000	0.0000	0.0004	0.0007

CONCLUSIONS AND FUTURE WORK

The inclusive quantification of uncertainty in building energy conservation equations has been demonstrated and the merits of this approach described. These include not only a reduction in simulation effort but potentially allow control of algorithm choice during simulation to minimize the effects of uncertainty on the output.

The implementation requires significant alterations to the structure of a simulation code. Although the ESP-r system was used in this study, the equations formed are generally applicable to any control volume conservation set, *e.g.* for mass and momentum as encountered in air flow simulation. By knowing the effects of uncertainty at all times in a simulation process, this information can be passed from one domain to another, *i.e.* the quantification of uncertainty would become fully integrated within the calculation procedure.

The method as described represents the initial implementation of a promising technique. The affine approach performs well when compared with existing external techniques. However, the method could be made more robust by several mechanisms. Further improvements to the affine calculations could be made with respect to maintaining correlations between sources of uncertainty. For example, matrix multiplication is calculated on a term by term basis and will introduce several (one for each multiplication) new uncertainty terms which are uncorrelated to all other uncertainty terms. The linear nature of the model could also be examined, potentially expanding the model to a quadratic or cubic

Table 7: External method solutions for conductivity uncertainty of 1%.

Time (hours)	Case 1			
	θ_0	$\delta\theta^+$	$\delta\theta^-$	σ
1	20.0003	0.0003	-0.0003	0.0002
2	20.0510	0.0017	-0.0010	0.0015
6	21.3119	0.0130	-0.0121	0.0125
12	23.4826	0.0177	-0.0164	0.0170
24	26.3728	0.0176	-0.0155	0.0165
120	29.9364	0.0026	-0.0011	0.0011

Time (hours)	Case 2			
	θ_0	$\delta\theta^+$	$\delta\theta^-$	σ
1	21.3572	0.0194	-0.0195	0.0200
2	25.1434	0.0408	-0.0414	0.0421
6	29.6194	0.0117	-0.0122	0.0122
12	29.9889	0.0005	-0.0006	0.0006
24	29.9972	0.0001	-0.0001	0.0001
120	29.9973	0.0000	0.0000	0.0000

Time (hours)	Case 3			
	θ_0	$\delta\theta^+$	$\delta\theta^-$	σ
1	27.8043	0.0027	-0.0028	0.0028
2	29.9699	0.0002	-0.0001	0.0002
6	29.9969	0.0000	0.0000	0.0000
12	29.9970	0.0000	0.0000	0.0000
24	29.9972	0.0000	0.0000	0.0000
120	29.9973	0.0000	-0.0001	0.0000

representation. Another avenue for investigation would be the representation of the uncertainty tokens by fuzzy numbers rather than interval numbers. The implementation of these tasks is non-trivial but, if achieved, would further improve this useful assessment technique.

REFERENCES

- CEN, 1997, *Transient conduction in building simulation software*, prEN ISO 13791
- Clarke J A, 2001, *Energy Simulation in Building Design*, Butterworth Heinemann, 2nd ed
- Kreyszig E, 1993, *Advanced Engineering Mathematics*, J Wiley and Sons, 7th ed
- Macdonald I A, 2002, *Quantifying the effects of uncertainty in building simulation*, PhD thesis, ESRU, University of Strathclyde
- Macdonald I A, Strachan P A, 2001, *Practical application of uncertainty analysis*, Energy and Buildings, Vol 33, pp 219-227
- Moore R E, 1966, *Interval Analysis*, Prentice-Hall
- Neumaier A, 1990, *Interval Methods for Systems of Equations*, Cambridge University Press
- Stolfi J, de Figueiredo L H, 1997, *Self-validated numerical methods and applications*, 21st Brazilian Mathematics Colloquium